
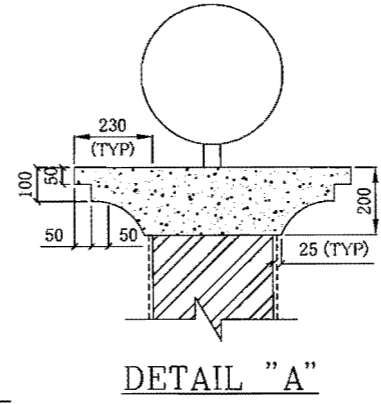
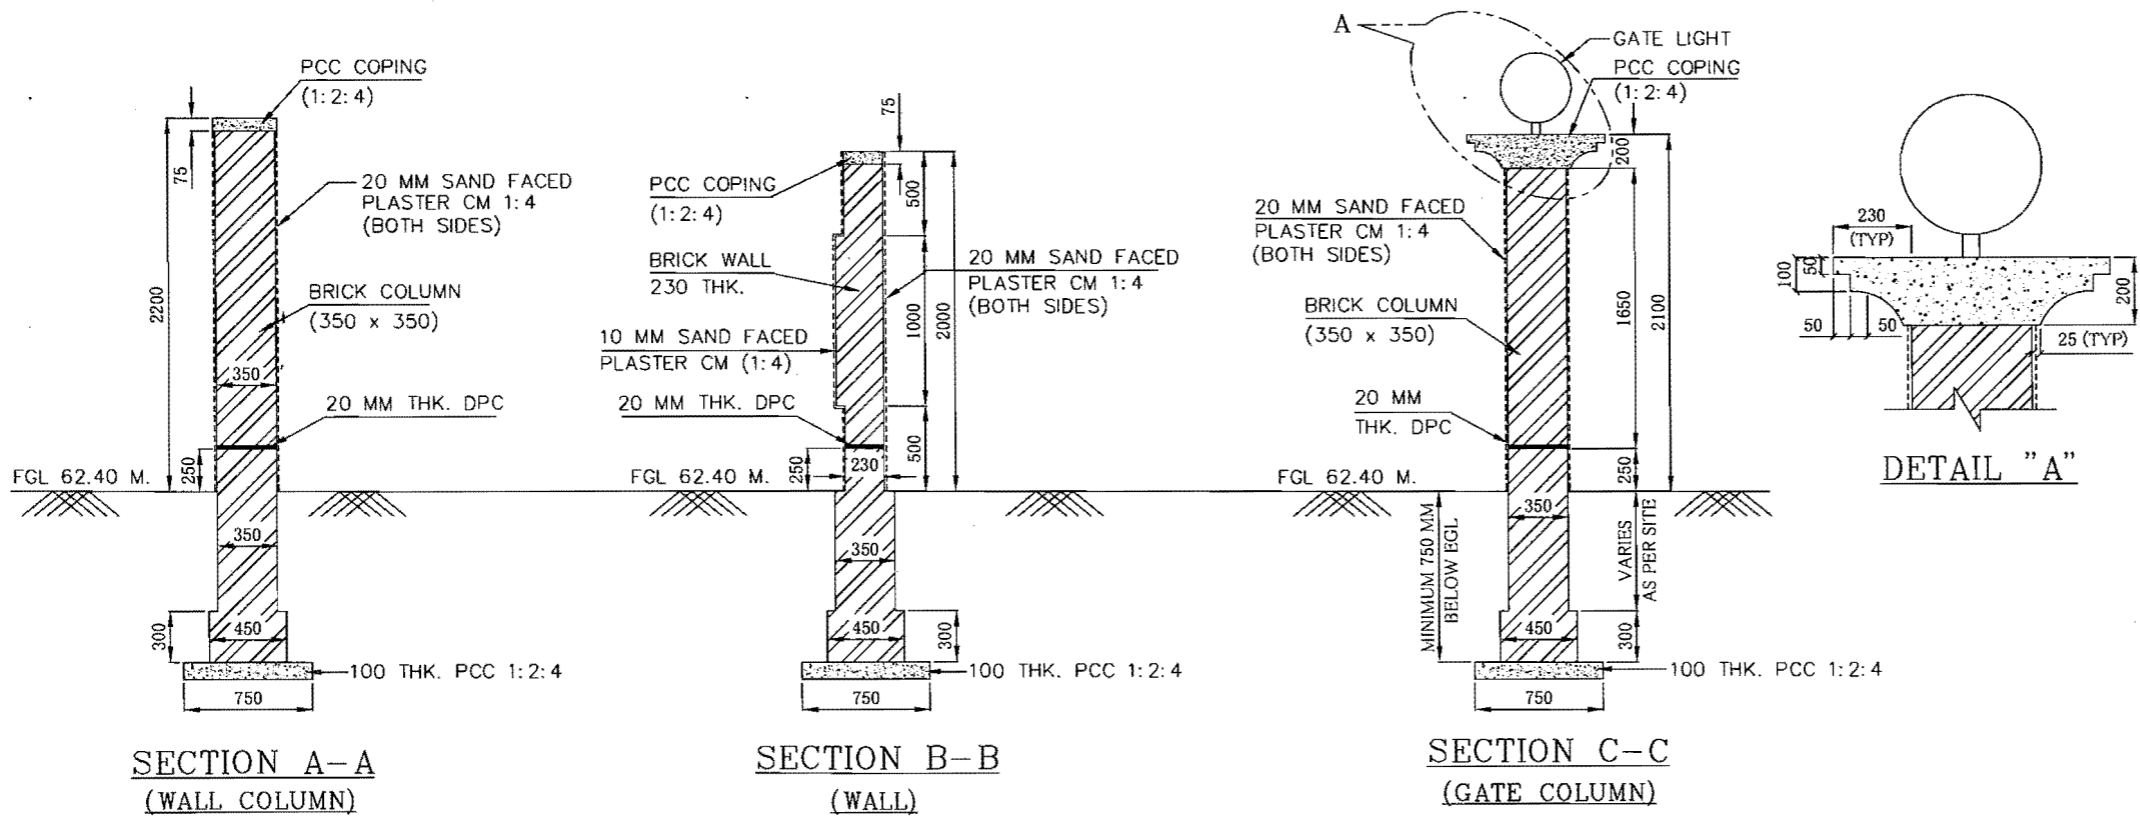


TABLE FOR COLUMN		
S. NO.	DESCRIPTION	NOS.
1	GATE COLUMNS	3
2	WALL COLUMNS (APPROX.)	161

- NOTES: -**
- 1.) ALL DIMENSIONS ARE IN MM.
 - 2.) REFER BUXAR STP SITE SOIL REPORT NO. G (D) 3612 SUBMITTED VIDE LETTER REF. TT/BEI/IND/1053/125 DT. 15.06.2012. ADEQUATE SOIL BEARING CAPACITY IS AVAILABLE TO SUPPORT BOUNDARY WALL (.)
 - 3.) FGL CONSIDERED RL 62.40 M. AS PER BUXAR STP HYDRAULIC FLOW DIAGRAM DRG. NO. TT/BEI/BUX/1053/STP/A09 REV.0 (.)
 - 4.) PROVIDE 25 MM GAP AT 30 M. C/C WITH WALL COLUMN BOTH SIDES OF GAP FOR EXPANSION JOINT (.) FOOTING UNDER EXPANSION JOINT GAP WILL BE CONTINUOUS (.)
 - 5.) MINIMUM DEPTH OF BOUNDARY WALL FOUNDATION IS TO BE MAINTAINED 750 MM BELOW EGL (.)



1	09.10.12	FOUNDATION DEPTH INCREASED TO 750 MM FROM 600 MM (.)	MS	DR. ADUTT	
0	05.10.12	SUBMISSION FOR APPROVAL	MS	DR. ADUTT	
REV.	DATE	DESCRIPTION	DRN.	CHKD.	APPD.
CLIENT: - BIHAR URBAN INFRASTRUCTURE DEVELOPMENT CORPORATION LTD., PATNA					
PROJECT: - 16.0 MLD SEWAGE TREATMENT PLANT AT BUXAR, BIHAR					
BIDDERS NAME: - TRI-TECH (BEIJING) COMPANY LTD. BEIJING, NEW DELHI					
DATE: - 05.10.12		TITLE: - CIVIL G.A. DRG. AND DETAIL OF BOUNDARY WALL FOR STP			
DRAWN: - M.S.		SCALE/SHEET			
CHKD: - DR. ADUTT		DRAWING NO.		REV.	
APPD: - DR. ADUTT		1:100 1 OF 1		TT/BEI/BUX/1053/STP/C29 1	